



Controller power supply via junction box
7.03.751 Cable junct. Dunker DB9

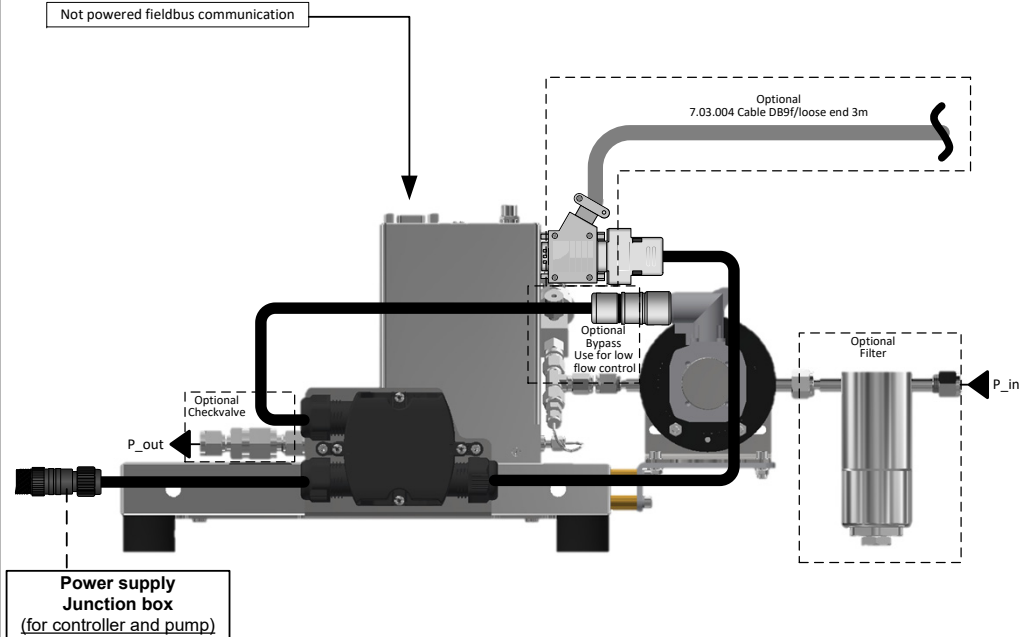


Controller power supply via powered fieldbus
7.03.749 Cable junct. Dunker M8 4p male

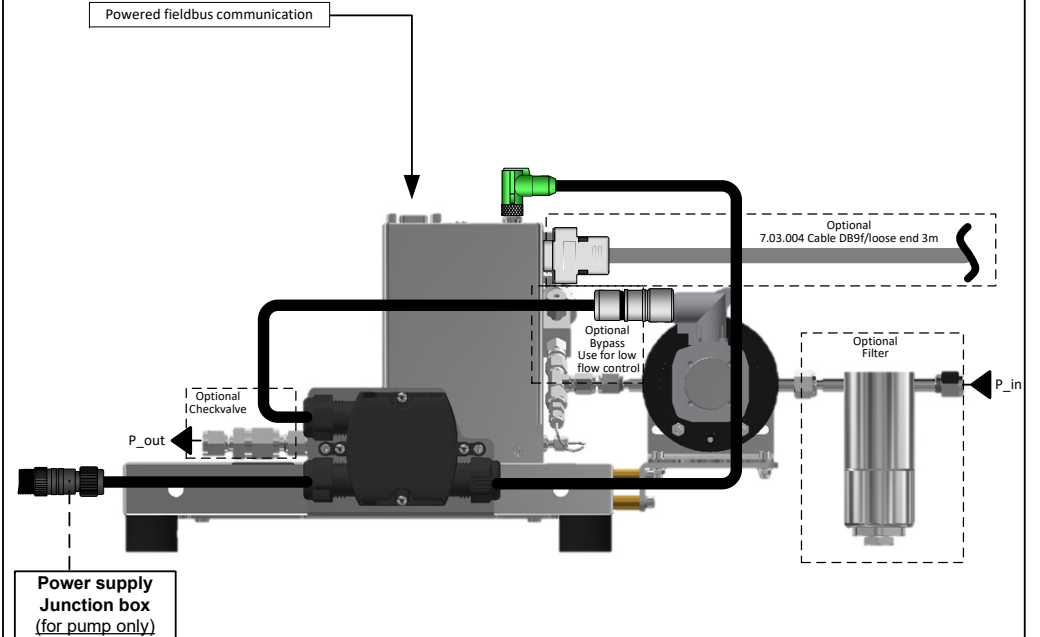

When connecting the system to other devices, be sure that the integrity of the shielding is not affected. Do not use unshielded wire terminals. Keep unconnected wire ends isolated.

Power supply Junction box

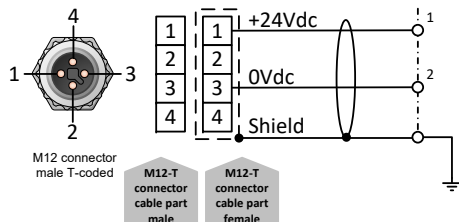

Note: Pump (BG45) needs: 24 Vdc (min. 4A) Power supply

Hook-up diagrams

Fieldbus hook-up for mini CORI-FLOW ML120 can be downloaded at:
<https://www.bronkhorst.com/int/products/liquid-flow/mini-cori-flow/ml120v00/>